

Before field wiring this appliance - Check existing wiring; replace if necessary.

NOTE: If any of the original wire supplied with the appliance must be replaced, it must be replaced with wiring material having a temperature rating of at least 105° C.

Figure 3.22 • Internal Ladder Wiring Diagram

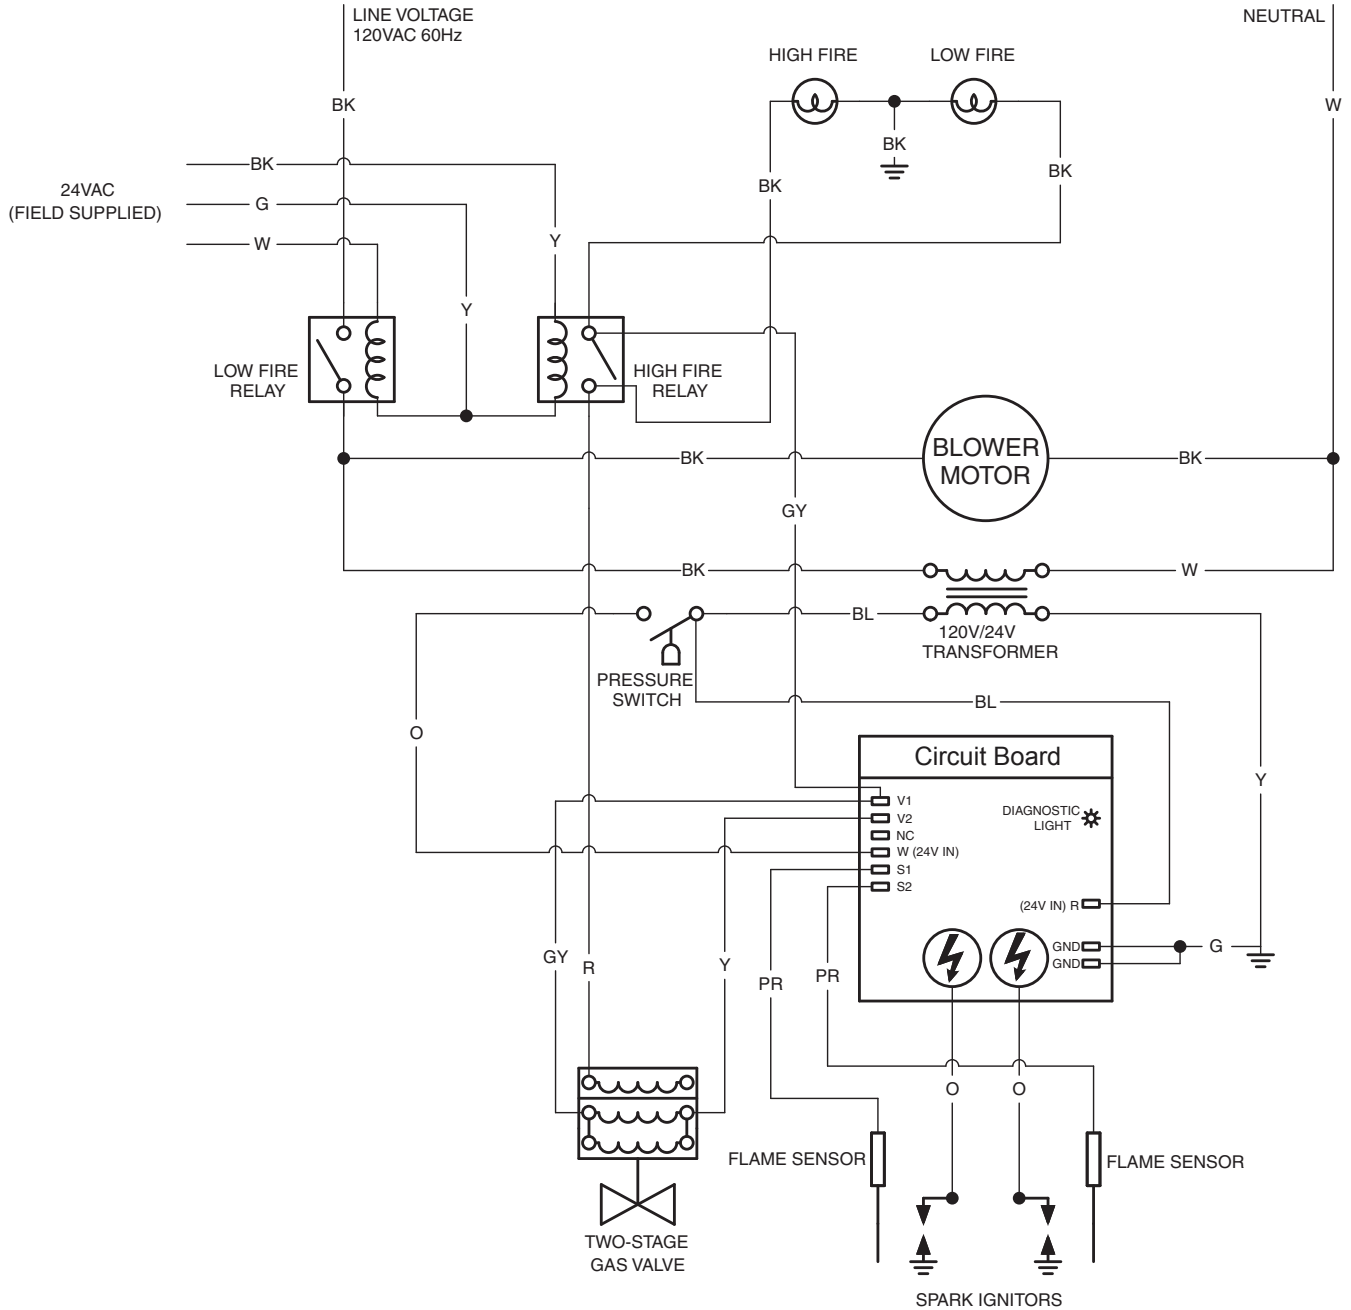


Figure 3.23 • Internal Block Wiring Diagram

