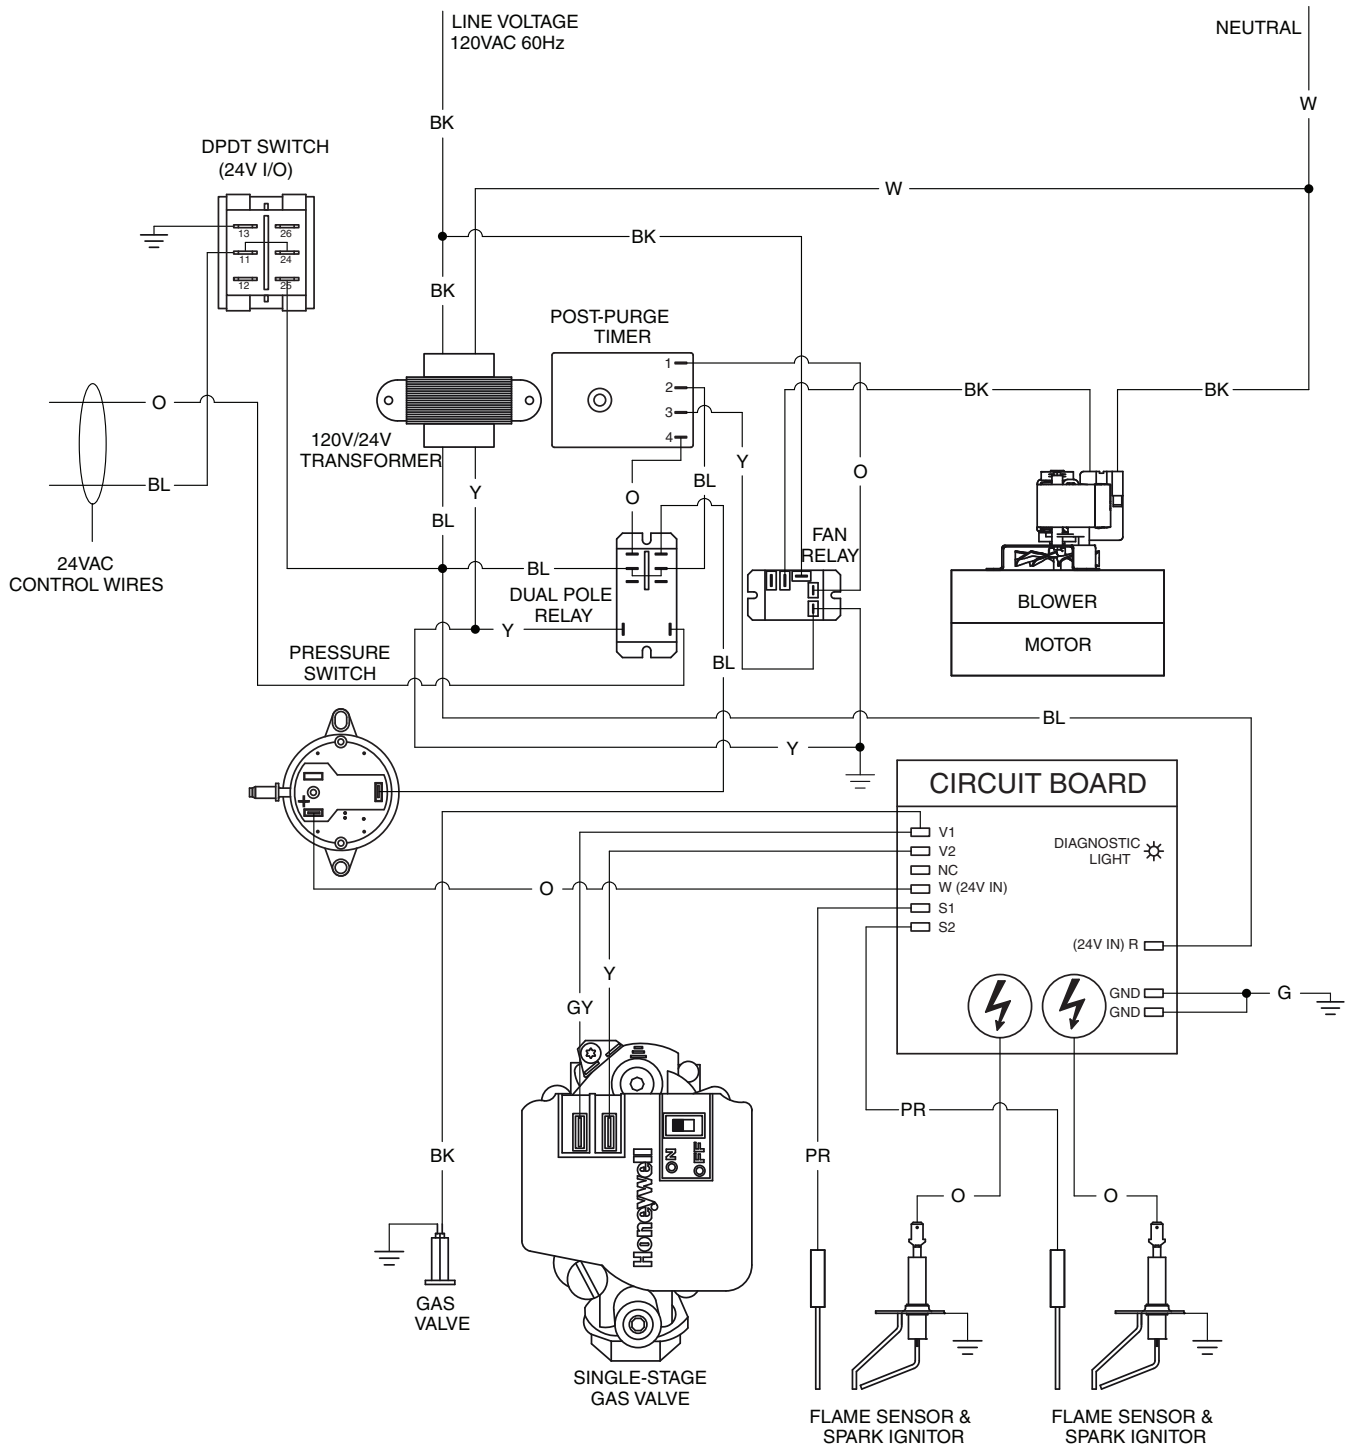


**Before field wiring this appliance - Check existing wiring; replace if necessary.**

**NOTE:** If any of the original wire supplied with the appliance must be replaced, it must be replaced with wiring material having a temperature rating of at least 105° C.

**Figure 3.23 • Internal Block Wiring Diagram**



**Figure 3.24 • Internal Ladder Wiring Diagram**

