


Alternative Wiring Diagrams

For 24VAO (Internal Relay Option), and Retail Super Centers.

BLOCK DIAGRAM - MARK17DU-117 WITH LIGHTS

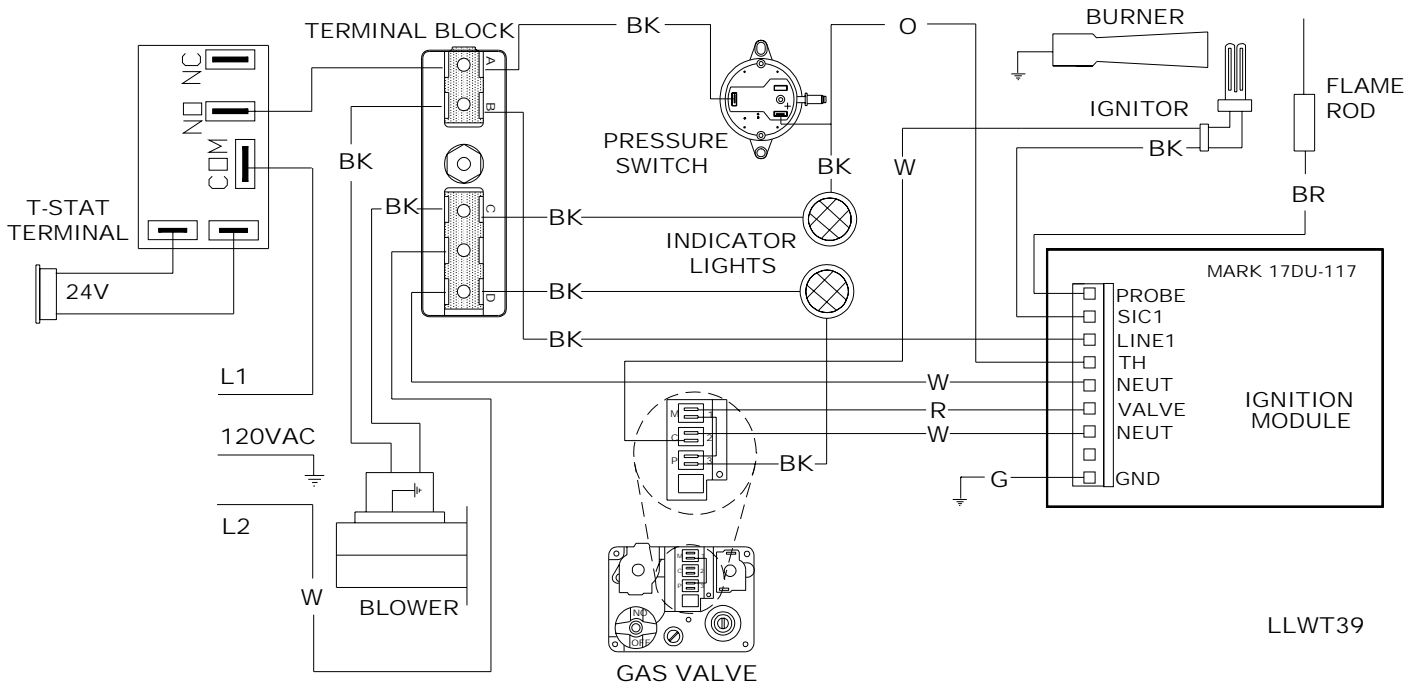


LLWT39

If any of the original wire as supplied with the appliance must be replaced, it must be replaced with wiring material having a temperature rating of at least 105°C.

For Obsolete Dual Switch Line Voltage, and 24VAO.

BLOCK DIAGRAM - MARK17DU-117 WITH LIGHTS

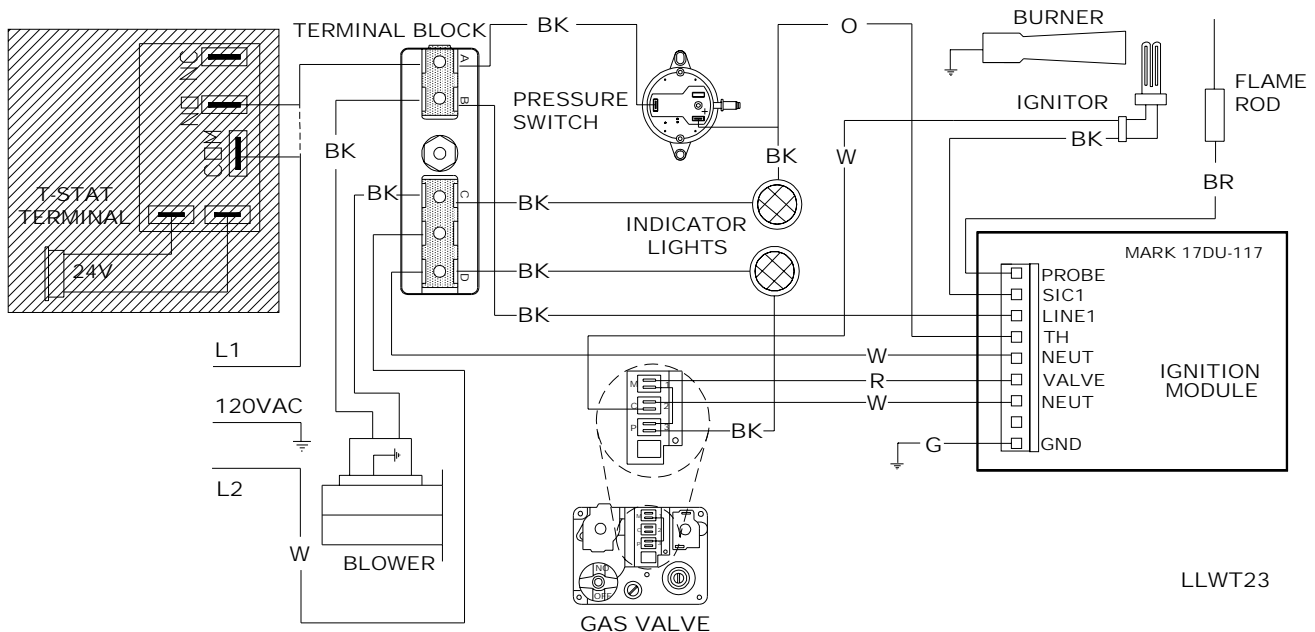

LLWT23